



**Hellenic Gas Transmission System Operator S.A.**  
357-359 Messogion Av., GR 152 31 Halandri  
Tel.: 213 088 4000  
Fax: 210 674 9504  
Email: desfa@desfa.gr

## TECHNICAL SPECIFICATION

**Doc No: DSF-SPC-MEC-012**

Rev. 1

Page 1 of 12

## HIGH PRESSURE (HP) TRANSMISSION SYSTEMS

# FIRE PROOFING

JUNE 2021

*This document is the property of DESFA S.A. and shall not be reproduced, copied or used for any purpose, other than for which it is specially furnished*

1	Second Issue	30-06-2021	MP	DK	TPI
0	First Issue	05-04-2011	PQ DPT.		V.G.
REV	DESCRIPTION	DATE	PRPD	CHKD	APVD



**Hellenic Gas Transmission System Operator S.A.**  
357-359 Messogion Av., GR 152 31 Halandri  
Tel.: 213 088 4000  
Fax: 210 674 9504  
Email: [desfa@desfa.gr](mailto:desfa@desfa.gr)

## TECHNICAL SPECIFICATION


**Doc No: DSF-SPC-MEC-012**

Rev. 1

Page 2 of 12


## REVISION HISTORICAL SHEET

[illegible]

	<b>Hellenic Gas Transmission System Operator S.A.</b> 357-359 Messogion Av., GR 152 31 Halandri Tel.: 213 088 4000 Fax: 210 674 9504 Email: desfa@desfa.gr	<b>TECHNICAL SPECIFICATION</b>
<b>Doc No: DSF-SPC-MEC-012</b>	Rev. 1	Page 3 of 12

## Table of Contents

REFERENCES DOCUMENTS.....	4
1. SCOPE .....	5
2. GENERAL.....	5
3. DESIGNATION OF STEEL TO BE FIRE PROOFED .....	5
4. EXTENT OF APPLICATION OF FIRE PROOFING.....	6
5. PREPARATION .....	7
6. MATERIALS AND APPLICATION.....	7

 <p><b>Hellenic Gas Transmission System Operator S.A.</b>  357-359 Messogion Av., GR 152 31 Halandri  Tel.: 213 088 4000  Fax: 210 674 9504  Email: desfa@desfa.gr</p>	<p><b>TECHNICAL SPECIFICATION</b></p>	
<p><b>Doc No: DSF-SPC-MEC-012</b></p>	<p>Rev. 1</p>	<p>Page 4 of 12</p>


## REFERENCES DOCUMENTS

ELOT EN 60079  
[Explosive atmospheres]

«Κανονισμός Πυροπροστασίας Κτιρίων», Π.Δ. 41/2018 (ΦΕΚ 80Α  
[Fire Protection Greek Regulation]

«Ελληνικός Κανονισμός Τεχνολογίας Σκυροδέματος»  
[Hellenic Concrete Technology Regulation] **ΚΤΣ-2016 ΦΕΚ 1561Β - 2016 + ΤΡΟΠΟΠΟΙΗΣΗ  
466Β - 2018**

All standards or codes mentioned in this specification are valid in their latest version or by the relative superseded edition.

	<b>Hellenic Gas Transmission System Operator S.A.</b> 357-359 Messogion Av., GR 152 31 Halandri Tel.: 213 088 4000 Fax: 210 674 9504 Email: desfa@desfa.gr	<b>TECHNICAL SPECIFICATION</b>
<b>Doc No: DSF-SPC-MEC-012</b>	Rev. 1	Page 5 of 12

## 1. SCOPE

This job specification shall be the basis for designating equipment and structural steel which is to be fire proofed and extent of fire proofing of supporting elements of equipment and piping by means of fire-resistant coverings.

In case of conflict between this specification and mandatory local codes, the latter and the most stringent shall govern.

## 2. GENERAL

For the purpose of this specification, "Fireproofed" will be considered synonymous with "Fire Resistive" as adopted by the National Legislation for Fire Protection (Π.Δ. 41/2018 (ΦΕΚ 80Α)).

Hazardous area is defined as the area inside a battery limit or an area within 9 m horizontally of a potential source of fire.

Hazardous equipment is defined as that containing flammable material, other combustible liquids or liquids with atmospheric boiling points below -29°C. Equipment such as vessels, exchangers, tanks, drums and air heaters which fulfill the above requirements is considered hazardous. Piping shall not be considered combustible containing equipment.

Classification of flammable and combustible liquids shall be in accordance with **EN 60079** series.

Fireproofing shall be used to protect containers of combustible materials, firefighting operations, and firefighting personnel from the effects of support failure during a fire of approximately 1 1/2 hours duration.

Protection shall be achieved by fireproofing only the supporting elements of equipment and structures in fire hazardous areas that might directly extent a fire of hinder firefighting operations as follows:

- a. Cause container rupture and consequent dumping of combustible contents through collapse of the container supports or through collapse of an adjacent tall slender structure on the container or the container supports.
- b. Cause a hazard to firefighting operations of firefighting personnel through collapse of a tall slender structure or a structure supporting heavy equipment.

## 3. DESIGNATION OF STEEL TO BE FIRE PROOFED

All structural steel supporting hazardous equipment or supporting process equipment in a hazardous area shall be fire proofed.

Structural steel supporting other equipment shall not be fire proofed unless its collapse would endanger fire proofed equipment.

	<b>Hellenic Gas Transmission System Operator S.A.</b> 357-359 Messogion Av., GR 152 31 Halandri Tel.: 213 088 4000 Fax: 210 674 9504 Email: desfa@desfa.gr	<b>TECHNICAL SPECIFICATION</b>
<b>Doc No: DSF-SPC-MEC-012</b>	Rev. 1	Page 6 of 12

Steel pipe racks in hazardous areas shall be fireproofed from grade up to an elevation where the highest load is applied (i.e. first level).

## 4. EXTENT OF APPLICATION OF FIRE PROOFING

### 4.1. STRUCTURAL STEEL (ALL EQUIPMENT)

Columns, beams and horizontal strut bracing of structural steel shall be fire proofed from grade to an elevation where the highest important equipment load is applied to the structure. All bracing, with the exception of wind bracing, shall be considered as structural steel requiring fire proofing.

### 4.2. VESSEL SUPPORTS

All lugs, brackets and legs supporting process equipment located in hazardous areas shall be completely fire proofed.

On horizontal or vertical vessels which have slots in the base supports to accommodate differential thermal expansion, the application of fire proofing shall not interfere with the motion.

Saddles, supporting process equipment in hazardous areas and measuring more than 30 cm in height at their lowest points shall be fire proofed.

### 4.3. VERTICAL EQUIPMENT SKIRTS

Steel skirts for vertical equipment (drums, etc.) shall be fire proofed from the equipment insulation to the foundation, including the base ring and bolt boxes.


Skirts with a diameter less than 1,2 m normally shall be fire proofed on the outside only; if there have non-welded connections at the interior area of the skirts then fire proof shall be applied on the inside surfaces of the skirt

Skirts with diameters greater than 1,2 m shall have fire proofing on the outside and inside surfaces.

Bottom heads of non-insulated vessels having skirt diameter greater than 1,2 m shall be fire proofed.

On vessels with a diameter less or equal than 1.2m, inside of skirts, and the bottom heads if they are not insulated, they shall be fire proofed only if the skirt access opening diameter is greater than 50 cm or if there are more than one access openings.

### 4.4. PIPE SUPPORTS

	<b>Hellenic Gas Transmission System Operator S.A.</b> 357-359 Messogion Av., GR 152 31 Halandri Tel.: 213 088 4000 Fax: 210 674 9504 Email: desfa@desfa.gr	<b>TECHNICAL SPECIFICATION</b>
<b>Doc No: DSF-SPC-MEC-012</b>	Rev. 1	Page 7 of 12

In hazardous areas, pipe rack bents supporting piping shall be fire proofed to the first level, including horizontal members at the first level. Pipe rack bents supporting (hazardous equipment except piping) shall be fire proofed up to the point of support of the equipment.

#### **4.5. THE FOLLOWING WILL NOT BE FIRE PROOFED**

Structures which support auxiliary equipment, such as storage hoppers, elevators, etc.

Diagonal bracing provided only for wind loading.

Stairways and platforms not designated for fire- fighting.

Maintenance structures, such as for tube bundle removal.

Top flanges of support beams for air heaters and piping.

Equipment handling or storing flammable gaseous or vaporous fluids which would rise rather than settle upon release; e.g. natural gas, hydrogen etc.

Equipment storing liquids which would flash if released to the atmosphere.

### **5. PREPARATION**

Steel work to be fire proofed should be free from scale, rust, grease, dirt and any foreign matter which would impair the bond between the surface to be fire proofed and the proofing material.

### **6. MATERIALS AND APPLICATION**

Concrete which shall be used for fireproofing shall have a minimum cube strength of 225 kp/cm<sup>2</sup> at 28 days and the size of aggregate shall not be greater than 8mm. Cement shall be Portland Cement.


Reinforcement shall be welded steel wire mesh 50x50mm with steel bar diameter 2-3mm or similar.

Fire proofing concrete shall be gun applied, poured or trowelled to give a minimum cover of 50 mm.

Reinforcement shall be wrapped around the structural steel members and lapped and wired where the member is fully fire proofed, and U-bent and wired to rods shall be provided where the top flange is exposed. For details see attached standards.

Reinforcement and spacers shall be binded in place with a 1.5mm diameter annealed iron wire, before concrete is placed.

Welded studs or blank square nuts, welded edge-on or steel rod spacers shall be used to provide a cover of 20mm between steel reinforcement and the face of the vessel skirt.

 <p><b>Hellenic Gas Transmission System Operator S.A.</b>  357-359 Messogion Av., GR 152 31 Halandri  Tel.: 213 088 4000  Fax: 210 674 9504  Email: desfa@desfa.gr</p>	<p><b>TECHNICAL SPECIFICATION</b></p>	
<p><b>Doc No: DSF-SPC-MEC-012</b></p>	<p>Rev. 1</p>	<p>Page 8 of 12</p>

Gunitite shall be used as an alternative fire proofing material. Gunitite is pneumatically premixed sand and cement thrown on the steel surface by compressed air ejector which forms a very dense, high strength concrete. Water is added to the dry materials mixture as it passes through the nozzle of the ejector.

### **6.1. GUNITITE INGREDIENTS**

Cement shall be Portland cement.

Sand shall be high silica sand with clean, sharp, hard, durable particles conforming to “**Hellenic Concrete Technology Regulation**” (ΚΤΣ-2016 ΦΕΚ 1561Β - 2016 + ΤΡΟΠΟΠΟΙΗΣΗ 466Β - 2018).

The sand shall be neither excessively dry nor wet; moisture shall be about 4% by weight.

Water shall be potable water in quality and free from injurious amount of oil, acid, alkali or organic matter.

### **6.2. GUNITITE MIXTURE**

The proportions of cement to sand mix shall be approximately 1 part of cement to 3.5 parts sand (dry and loose volumes).

Cement and sand shall be passed thru a 6 mm mesh sieve to remove any lumps and then shall be thoroughly premixed before added to the hopper of the ejector.

Water content shall be maintained to insure proper consistency of the mix. Reinforcement shall be as per above **para 6.1 to 6.2**.





Hellenic Gas Transmission System Operator S.A.  
357-359 Messogion Av., GR 152 31 Halandri  
Tel.: 213 088 4000  
Fax: 210 674 9504  
Email: desfa@desfa.gr



## TECHNICAL SPECIFICATION

Doc No: DSF-SPC-MEC-012


Rev. 1

Page 9 of 12

### Formed Concrete Details

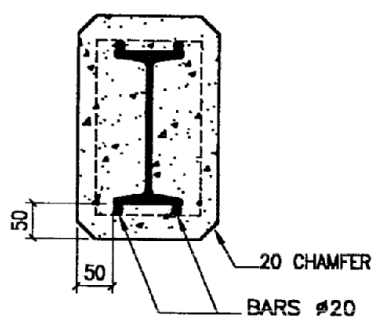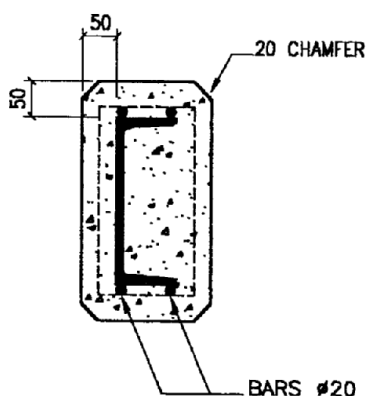

FOR PIPE OR CHECKERED  
PLATE SUPPORTS

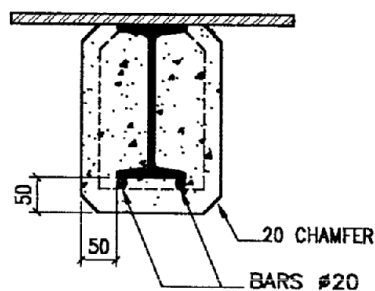

FOR ALL BEAMS AND COLUMNS



Hellenic Gas Transmission System Operator S.A.  
357-359 Messogion Av., GR 152 31 Halandri  
Tel.: 213 088 4000  
Fax: 210 674 9504  
Email: desfa@desfa.gr



## TECHNICAL SPECIFICATION

Doc No: DSF-SPC-MEC-012



Rev. 1

Page 10 of 12

### Gunite Details

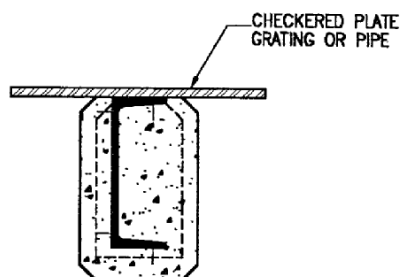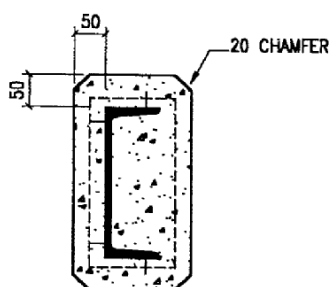

#### ALL CHANNELS

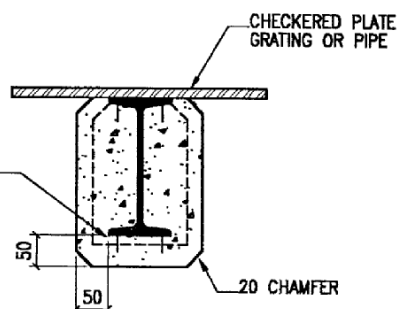
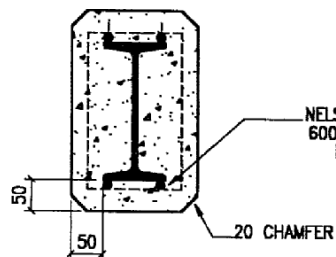


#### I BEAMS AND COLUMNS LESS THAN 300

50x50 No.12 MESH 20mm  
CLEARANCE FROM MEMBER

SLOPED FACE TO PERMIT  
PAINTING AND MINIMIZE  
MOISTURE RETENTION

CHECKERED PLATE  
GRATING OR PIPE

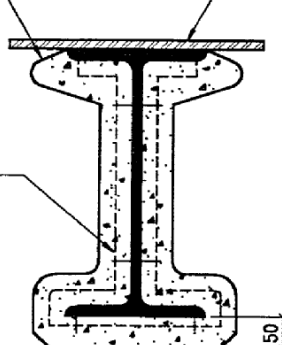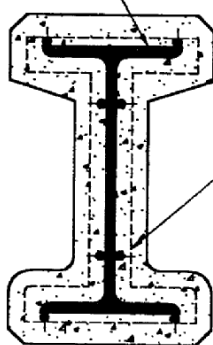

#### I BEAMS AND COLUMNS – 300 AND LARGER



Hellenic Gas Transmission System Operator S.A.  
357-359 Messogion Av., GR 152 31 Halandri  
Tel.: 213 088 4000  
Fax: 210 674 9504  
Email: desfa@desfa.gr


## TECHNICAL SPECIFICATION

Doc No: DSF-SPC-MEC-012

Rev. 1

Page 11 of 12

### Tower Skirts

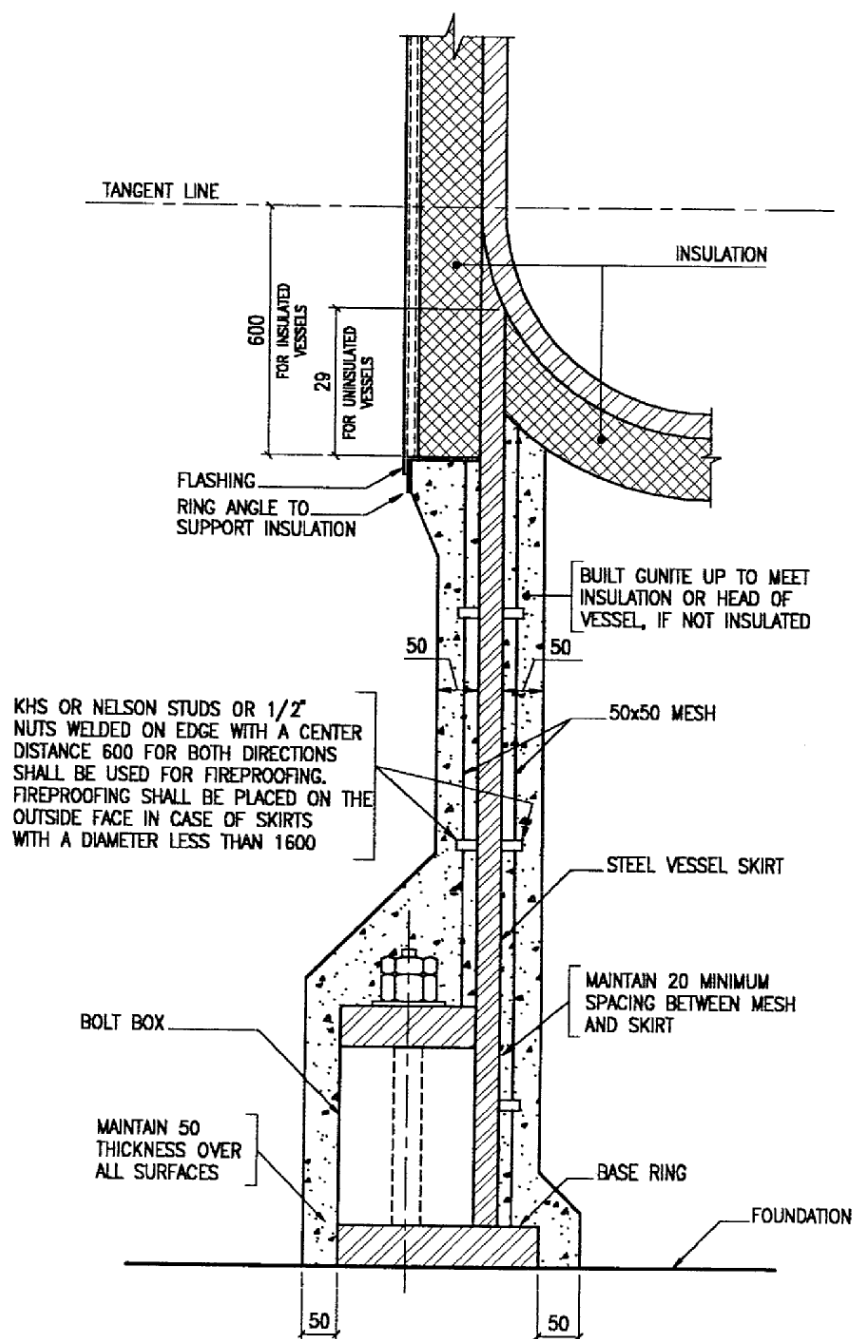

#### NOTE:

- IF OPENINGS, SUCH AS MANHOLES, ARE ENCOUNTERED, USE 4 STUDS OR NUTS AROUND OPENING. WHEN NUTS ARE USED ON EDGES WIRE MESH WITH 116 GALVANIZED WIRE SHALL BE USED.



Hellenic Gas Transmission System Operator S.A.  
357-359 Messogion Av., GR 152 31 Halandri  
Tel.: 213 088 4000  
Fax: 210 674 9504  
Email: desfa@desfa.gr


## TECHNICAL SPECIFICATION

Doc No: DSF-SPC-MEC-012

Rev. 1

Page 12 of 12

### Gunite Details

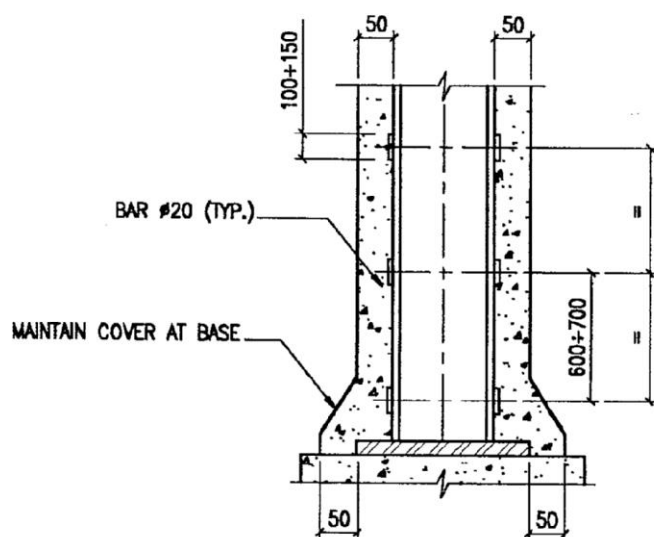

DETAIL AT COLUMN BASE